Circulating Fluid Temperature Controller

Low GWP Refrigerant Chiller





RoHS

New

Thermo-chiller Rack Mount Type

Air-cooled Refrigeration Water-cooled Refrigeration



EU refrigerant regulations: GWP150 or more US refrigerant regulations: GWP700 or more

California, US refrigerant regulations: GWP750 or more

310 mm

Equivalent to 7U

(EIA standards*3)

*1 Regulation (EU) 2024/573, AIM Act 40 CFR Part 84

Environmentally friendly R454C as refrigerant

Not available for air transport

Operable without the need to remove the unit from the rack


Front access

Simple to control, service, and maintain with all filters and drainage accessible via the front panel

Space saving

Multiple chillers can be mounted to a 19-inch rack.

*3 Refer below for details on 19-inch



Cooling capacity


1.2/1.8 kW (60 Hz)

Temperature stability

±0.1°C

Power supply

Single-phase **200** to **230 VAC** (50/60 Hz)

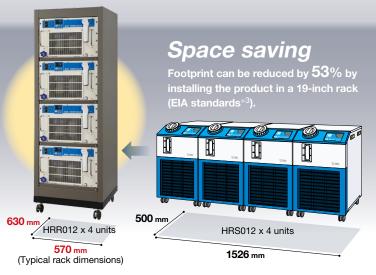

*3 19-inch Rack Standards

Standard	EIA (Electronic Industries Alliance)
Standard no.	EIA310-D
Height	44.5 mm (=1U)
Length	450 mm (min)
Width	483.4 mm





CONTENTS

HRRF Series



Circulating Fluid Temperature Controller

Low GWP Refrigerant Chiller

Thermo-chiller/Rack Mount Type HRRF Series

HRRF012/018

How to Order	
Air-cooled Refrigeration (Single-phase 200 to 230 VAC)	
Water-cooled Refrigeration (Single-phase 200 to 230 VAC)	·p. 2
Specifications	
Air-cooled Refrigeration (Single-phase 200 to 230 VAC)	
Water-cooled Refrigeration (Single-phase 200 to 230 VAC)	-
Cooling Capacity·····	
Heating Capacity·····	•
Pump Capacity	•
Required Facility Water Flow Rate·····	·p. 6
Dimensions	
Air-cooled Refrigeration	
Water-cooled Refrigeration	p. 7
Options	
With Electric Conductivity Control Function,	
Applicable to DI Water Piping	n 8
Applicable to DI Water Piping	
Inverter Pump Mounted	
High-Pressure Pump Mounted ·····	
With Feet/Without Rack Mounting Brackets······	
Removed Parts·····	
Optional Accessories	
① Concentration Meter	
② Particle Filter Element for Replacementp	
③ DI Filter Replacement Cartridgep	
④ Anti-quake Bracket ·····p	
Piping Conversion Fitting (For Air-cooled Refrigeration)	
Piping Conversion Fitting (For Water-cooled Refrigeration)	
⑦ Power Supply Cablep	ງ. 12
Caster Adjuster-foot Kit	າ. 13
Cooling Capacity Calculation	
Required Cooling Capacity Calculationpp. 14	1 15
Precautions on Cooling Capacity Calculation	
Circulating Fluid Typical Physical Property Values······	
Shoulding Field Typical Fityologic Toporty values	,. 10
Specific Product Precautionspp. 16	3, 17




Low GWP Refrigerant Chiller


Single-phase 200 to 230 VAC HRRF012/018





How to Order

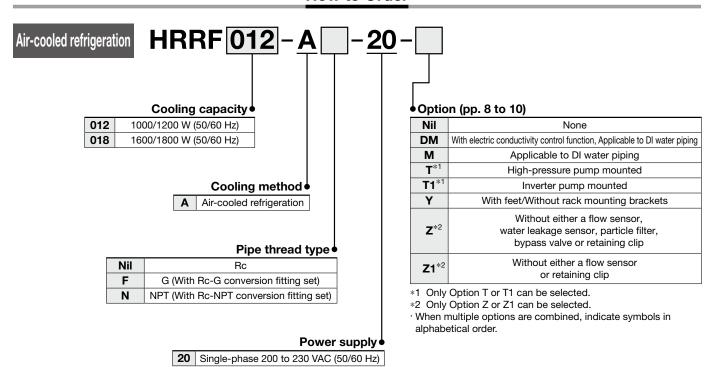

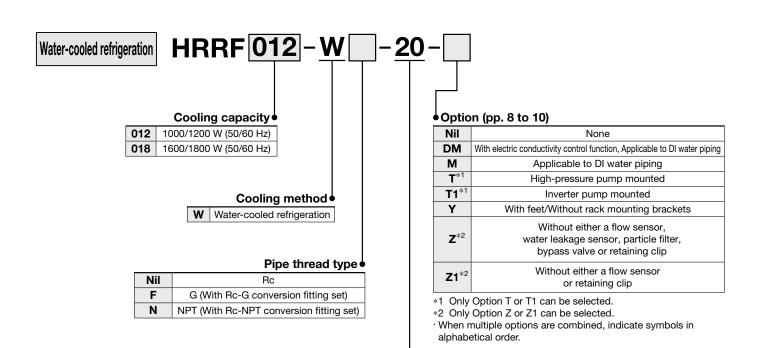

Power supply

20 Single-phase 200 to 230 VAC (50/60 Hz)



Specifications: 200 to 230 VAC Air-cooled Refrigeration

	Model		HRRF012-A-20 HRRF018-A-20		
Cooling method			Air-cooled refrigeration		
	efrigerant		R454C (HFO/HFC, GWP: 146)*21		
	efrigerant charge	[kg]	0.30		
	ontrol method		PID control		
Ar	nbient temperature/Humidity/Altitu	ude*1, 13	Temperature: 5 to 40°C, Humidity: 30 to 70%, Altitude: less than 3000 m		
	Circulating fluid*2		Tap water, 15% ethylene glycol aqueous solution		
	Set temperature range*1	[°C]	5 to 35		
	Cooling capacity (50/60 Hz)*3	[W]	1000/1200 1600/1800		
	Heating capacity (50/60 Hz)*4	[W]	450/500		
	Temperature stability*5	[°C]	±0.1		
system	Pump capacity (50/60 Hz)*6	[MPa]	0.13 (at 7 L/min)/0.18 (at 7 L/min) For Option T: 0.42 (at 10 L/min)/0.4 (at 14 L/min) For Option MT: 0.32 (at 10 L/min)/0.32 (at 14 L/min) For Option T1: 0.28 (at 10 L/min)/0.28 (at 10 L/min)		
S	Rated flow (50/60 Hz)*7	[L/min]	7/7 For Options T, MT: 10/14, For Option T1: 10/10		
fluid	Flow display range*20	[L/min]	2 to 16		
g f	Electric conductivity display range	[µS/cm]	0.1 to 48 (Only for Option DM)		
Circulating	Electric conductivity setting range	[µS/cm]	0.5 to 45 (Only for Option DM)		
<u>Ha</u>	Particle filter nominal filtration rating*19	⁹ [μ m]	5		
<u>2</u>	Bypass valve*19		Installed		
Ö	Tank capacity	[L]	Approx. 4		
	Outlet, Return port size		Rc1/2		
	Drain port size		Rc1/4, With cap		
	Leakage protection		Drain pan (With water leakage sensor*19)		
	Fluid contact material		Stainless steel, Copper (Heat exchanger brazing)*11, Brass*16, SiC, Alumina ceramic, Carbon, PP, PE, POM, PA, FKM, EPDM, PVC, PPS, AS, Fluoropolymer*12, Ion exchange resin*12		
	Power supply		Single-phase 200 to 230 VAC, 50/60 Hz, Allowable voltage range ±10%*14		
	Circuit protector	[A]	10 For Options T, MT, T1: 15		
	Applicable earth leakage breaker c		Rated current: 10 Å For Options T, MT, T1: 15 Å Sensitivity current: 30 mA		
Ē	Cable quantity x Size (Including grounding	cable)*15	3 cores x 14 AWG (3 cores x 2.0 mm ²)		
ste			4.9/5.9 5.1/6.2		
Electrical system	Rated operating current (50/60 Hz)*17	[A]	For Options T, MT 6.1/7.8 6.6/8.4		
Ξ̈́	(00/00112)		For Option T1		
ec			5.9/6.7 6.2/7.1		
ū			0.8/1.1 (1.0/1.2) 0.9/1.2 (1.0/1.3)		
	Rated power consumption		For Options T, MT		
	(50/60 Hz)*17	[kW (kVA)]	1.2/1.6 (1.2/1.6) 1.3/1.7 (1.3/1.7)		
	(00/00 112)		For Option T1		
			1.0/1.2 (1.2/1.4) 1.1/1.3 (1.3/1.4)		
Communication function			Contact input/output, Serial RS-485/RS-232C		
	pise level (50/60 Hz)*9	[dB]	59/60 59/60		
Accessories*18 Power supply connector, Particle filter element and maintenance handle*19, Operation maintenance handle *19, Operation maintena					
W	eight* ¹⁰	[kg]	45		

- *1 No condensation should be present. Use 15% ethylene glycol aqueous solution when operating at a temperature of 10°C or less.
- *2 If tap water is used, use water that is compliant with the Water Quality Standards of the Japan Refrigeration and Air Conditioning Industry Association (JRA GL-02-1994 cooling water system - circulating type make-up water).
- *3 ① Ambient temperature: 25°C, ② Circulating fluid temperature: 20°C, ③ Circulating fluid at the rated flow, ④ Circulating fluid: Tap water, ⑤ Power supply: 200 VAC, ⑥ Piping length: Shortest For Options "T," "MT" (high-pressure pump mounted type), and "T1" (inverter pump mounted type), the cooling capacity will decrease by approx. 300 W.
- *4 ① Ambient temperature: 25°C, ② Circulating fluid temperature: 20°C, ③ Circulating fluid at the rated flow, ④ Circulating fluid: Tap water, ⑤ Power supply: 200 VAC, ⑥ Piping length: Shortest
- *5 Temperature at the thermo-chiller outlet when the circulating fluid flow is at the rated flow and the circulating fluid outlet and return port are directly connected
 - The installation environment and power supply are within the specification range and stable.
- *6 The capacity at the thermo-chiller outlet when the circulating fluid temperature is 20°C
- *7 The required flow rate for maintaining the cooling capacity or temperature stability
 - The specification of the cooling capacity and the temperature stability may not be satisfied if the flow rate is lower than the rated flow.
- *8 Purchase an earth leakage breaker with a sensitivity current of 30 mA
- and a power supply of 200 VAC separately. *9 Front: 1 m, height: 1 m, stable with no load, Other conditions \rightarrow See *4.

- *10 Weight in the dry state without circulating fluids
 - The weight will increase by 1 kg when Option DM (With electric conductivity control function, Applicable to DI water piping) is selected. The weight will increase by 5 kg when Options T (High-pressure pump mounted) or MT (Applicable to DI water piping + High-pressure pump mounted) are selected.
 - The weight will increase by 1 kg when Options T1 (Inverter pump mounted) or Z (Removed parts) are selected.
- *11 Options M (Applicable to DI water piping) and MT (Applicable to DI water piping + High-pressure pump mounted) do not contain copper or brass.
- *12 For Option DM (With electric conductivity control function, Applicable to DI water piping)
- *13 If the product is used at an altitude of 1000 meters or higher, the maximum allowable ambient temperature and the cooling capacity decrease. For details, refer to the operation manual.
- *14 No continuous voltage fluctuation
- *15 To be prepared by the customer
- 16 Option T (High-pressure pump mounted) contains this material.
- 17 ① Ambient temperature: 25°C, ② Circulating fluid temperature: 20°C, ③ Circulating fluid at the rated flow, ④ Circulating fluid: Tap water, ⑤ Power supply: 200 VAC, ⑥ Piping length: Shortest, ⑦ With the rated cooling load applied
- *18 For Option DM (With electric conductivity control function, Applicable to DI water piping), a DI filter is included.
 - For pipe thread type F, a G thread conversion fitting set is included. For pipe thread type N, an NPT thread conversion fitting set is included.
- *19 Not included for Option Z (Removed parts)
- *20 Not included for Options Z and Z1 (Removed parts)
- *21 R454C is a slightly flammable refrigerant. Avoid using this product in proximity to open flames.



Specifications: 200 to 230 VAC Water-cooled Refrigeration

	Model		HRRF012-W-20	HRRF018-W-20	
Cooling method			Water-cooled refrigeration		
Re	efrigerant		R454C (HFO/HFC, GWP: 146)*22		
Refrigerant charge [kg]			0.22		
	ontrol method		PID con		
Ar	Ambient temperature/Humidity/Altitude*1, 14		Temperature: 5 to 40°C, Humidity: 30 t	o 70%, Altitude: less than 3000 m	
	Circulating fluid*2		Tap water, 15% ethylene g		
	Set temperature range*1	[°C]	5 to 3	5	
	Cooling capacity (50/60 Hz)*3	[W]	1000/1200	1600/1800	
	Heating capacity (50/60 Hz)*4	[W]	450/50	00	
	Temperature stability*5	[°C]	±0.1		
system	Pump capacity (50/60 Hz)*6	[MPa]	0.13 (at 7 L/min)/0. For Option T: 0.42 (at 10 L For Option MT: 0.32 (at 10 L For Option T1: 0.28 (at 10 L	/min)/0.4 (at 14 L/min) /min)/0.32 (at 14 L/min) /min)/0.28 (at 10 L/min)	
ŀ≅	Rated flow (50/60 Hz)*7	[L/min]	7/7 For Options T, MT: 10/1	•	
) f	Flow display range*21	[L/min]	2 to 1		
Circulating fluid	Electric conductivity display range	[μ S/cm]	0.1 to 48 (Only fo	1	
<u>a</u>	Electric conductivity setting range	[μ S/cm]	0.5 to 45 (Only fo	r Option DM)	
뒫	Particle filter nominal filtration rating*2	^Մ [μ m]	5		
Ιō	Bypass valve*20		Installe		
	Tank capacity	[L]	Approx		
	Outlet, Return port size		Rc1/2		
	Drain port size		Rc1/4, Wit		
	Leakage protection		Drain pan (With water I	eakage sensor ^{*20})	
	Fluid contact material		Stainless steel, Copper (Heat exchanger brazing)*11, POM, PA, FKM, EPDM, PVC, PPS, AS, Flu	Brass* ¹⁷ , SiC, Alumina ceramic, Carbon, PP, PE, loropolymer* ¹² , Ion exchange resin* ¹²	
ᇤ	Temperature range	[°C]	5 to 4	0	
water system	Pressure range	[MPa]	0.3 to 0	0.5	
te (Required flow rate (50/60 Hz)*13	[L/min]	8	12	
w	Inlet-outlet pressure differential of facility water	[MPa]	0.3 or m	nore	
Facility	Port size		Rc3/8	-	
Ξĕ	Fluid contact material		Stainless steel, Copper (Heat exchanger		
	Power supply		Single-phase 200 to 230 VAC, 50/60 Hz		
	Circuit protector	[A]	10 For Options		
	Applicable earth leakage breaker c	apacity*8	Rated current: 10 A For O Sensitivity curre		
_	Cable quantity x Size (Including grounding	cable*16	3 cores x 14 AWG (3		
te	Casic quantity x 6126 (moluting grounding	, Justoj	4.5/5.1	4.7/5.3	
system		-	4.5/5.1 For Options		
	Rated operating current	[A]	5.4/6.8	5.7/7.2	
Electrical	(50/60 Hz)*18	וייז	5.4/0.0 For Optio		
ह		}	5.6/6.2	5.8/6.4	
iie			0.8/1.0 (0.9/1.0)	0.8/1.0 (0.9/1.0)	
_		-	For Options T, MT		
	Rated power consumption	[kW (kVA)]	1.1/1.4 (1.1/1.4)	1.1/1.5 (1.2/1.5)	
	(50/60 Hz)* ¹⁸	[(m. 4)]	For Optio		
			1.0/1.1 (1.2/1.4)	1.0/1.2 (1.2/1.5)	
Co	ommunication function		Contact input/output, Ser		
	pise level (50/60 Hz)*9	[dB]	59/60	59/60	
	ccessories*19		Power supply connector, Particle filter element ar		
Weight*10 [kg] 45			, opolation manda		
	No condensation should be present 11			without circulating fluids and facility water (for water	

- *1 No condensation should be present. Use 15% ethylene glycol aqueous solution when operating at a temperature of 10°C or less.
 *2 If tap water is used, use water that is compliant with the Water Quality Stand-
- *2 If tap water is used, use water that is compliant with the Water Quality Standards of the Japan Refrigeration and Air Conditioning Industry Association (JRA GL-02-1994 cooling water system circulating type make-up water).
 *3 ① Facility water temperature: 25°C, ② Circulating fluid temperature: 20°C, ③ Circulating fluid at the rated flow, ④ Circulating fluid: Tap water, ⑤ Power supply: 200 VAC, ⑥ Piping length: Shortest For Options "T," "MT" (high-pressure pump mounted type), and "T1" (inverter pump mounted type), the cooling capacity will decrease by approx. 300 W.
 *4 ① Ambient temperature: 25°C, ② Facility water temperature: 25°C, ③ Circulating fluid temperature: 20°C, ④ Circulating fluid at the rated flow, ⑥ Circulating fluid: Tap water, ⑥ Power supply: 200 VAC, ⑦ Piping length: Shortest
 *5 Temperature at the thermo-chiller outlet when the circulating fluid flow is at the rated flow, and the circulating fluid outlet and return port are directly con-

- the rated flow and the circulating fluid outlet and return port are directly con-The installation environment and power supply are within the specification
- *6 The capacity at the thermo-chiller outlet when the circulating fluid tempera-
- ture is 20°C The required flow rate for maintaining the cooling capacity or temperature stability
- The specification of the cooling capacity and the temperature stability may not be satisfied if the flow rate is lower than the rated flow. Purchase an earth leakage breaker with a sensitivity current of 30 mA and a power supply of 200 VAC separately.
- *9 Front: 1 m, height: 1 m, stable with no load, Other conditions → See *4.

- *10 Weight in the dry state without circulating fluids and facility water (for water-

 - Weight in the dry state without circulating fluids and facility water (for water-cooled refrigeration)

 The weight will increase by 1 kg when Option DM (With electric conductivity control function, Applicable to DI water piping) is selected.

 The weight will increase by 5 kg when Options T (High-pressure pump mounted) or MT (Applicable to DI water piping + High-pressure pump mounted) are selected.

 The weight will increase by 1 kg when Options T1 (Inverter pump mounted) or Z (Removed parts) are selected.

 Options M (Applicable to DI water piping) and MT (Applicable to DI water piping + High-pressure pump mounted) do not contain copper or brass.
- ing + High-pressure pump mounted) do not contain copper or brass.


 *12 For Option DM (With electric conductivity control function, Applicable to DI water piping)
- The required flow rate when the cooling capacity load is applied under the conditions in *3. The actual flow rate of facility water will fluctuate according to your operating conditions.
- *14 If the product is used at an altitude of 1000 meters or higher, the maximum allowable ambient temperature and the cooling capacity decrease. For details, refer to the operation manual. No continuous voltage fluctuation
- *16 To be prepared by the customer
- *16 De prepared by the customer
 *17 Option T (High-pressure pump mounted) contains this material.
 *18 ① Facility water temperature: 25°C, ② Circulating fluid temperature: 20°C, ③ Circulating fluid at the rated flow, ④ Circulating fluid: Tap water, ⑤ Power supply: 200 VAC, ⑥ Piping length: Shortest, ⑦ With the rated cooling load applied
 *19 For Option DM (With electric conductivity control function, Applicable to DI water piping). ② It filter included
 - water piping), a DI filter is included.
 For pipe thread type F, a G thread conversion fitting set is included.
 For pipe thread type N, an NPT thread conversion fitting set is included.
- *20 Not included for Option Z (Removed parts)
 *21 Not included for Options Z and Z1 (Removed parts)
 - R454C is a slightly flammable refrigerant. Avoid using this product in proximity to open flames.





Cooling Capacity

- * If the product is used at an altitude of 1000 meters or higher, the maximum allowable ambient temperature and the cooling capacity decrease. For details, refer to the operation manual.
- * For models with a high-pressure pump mounted (-T, -MT), the cooling capacity will decrease by about 300 W from each graph.


HRRF012-A-20, HRRF012-W-20 [50 Hz] 2500 Ambient temperature or facility water temperature 2000 Cooling capacity [W] 25°C 1500 1000 32°C 500 40°C 0 0 20 30 40 Circulating fluid temperature [°C]

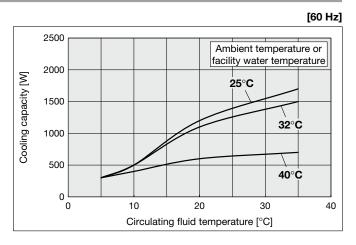


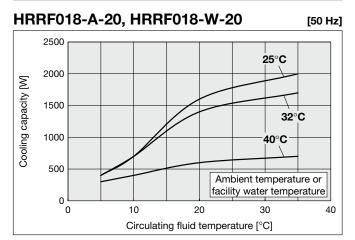

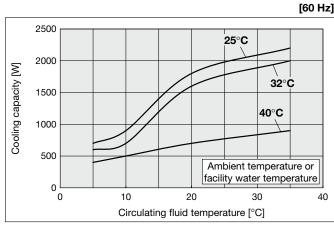


Heating Capacity

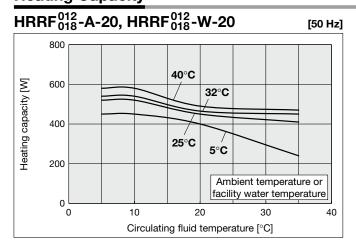

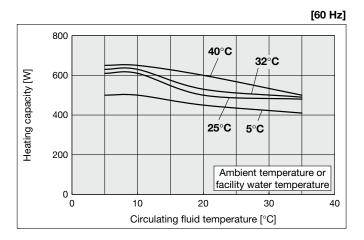

Pump Capacity


HRRF⁰¹²₀₁₈-A-20, HRRF⁰¹²₀₁₈-W-20

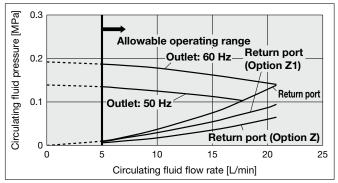

^{*} The flow rate is displayed up to 16 L/min on the chiller display.

Required Facility Water Flow Rate

HRRF₀₁₈-W

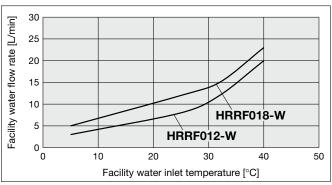


* This is the required facility water flow rate at the circulating fluid rated flow and the cooling capacity listed in the "Cooling Capacity" specifications.




Dimensions

Air-cooled refrigeration

HRRF012-A, HRRF018-A

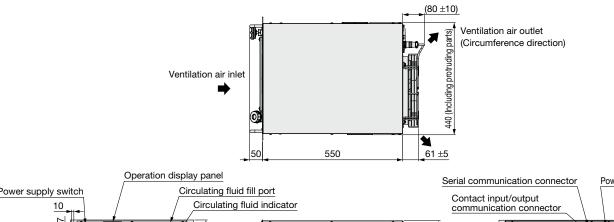


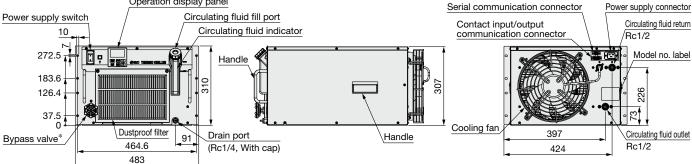

^{*} In the case of Option Z, without the bypass valve.

Water-cooled refrigeration

HRRF012-W, HRRF018-W

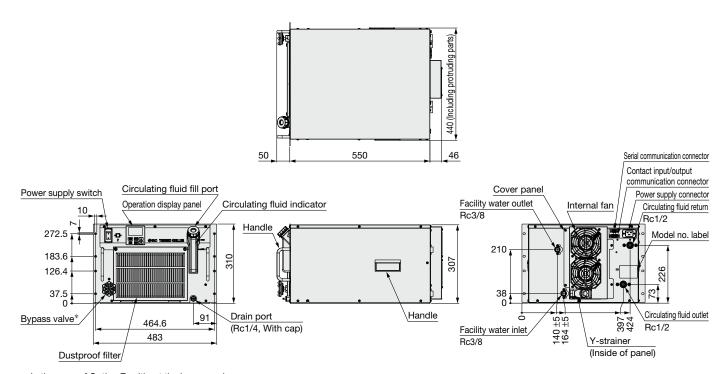

- * In the case of Option Z, without the bypass valve.
- * For the dimensions of Option Y, refer to the following drawing. HRRF012-W \square -20- \square Y \square
- * Only Option Z or Z1 can be selected.
- * Only Option T or T1 can be selected.



HRRF Series Options

 Options have to be selected when ordering the thermo-chiller.
 It is not possible to add them after purchasing the unit.

Option symbol

With Electric Conductivity Control Function, Applicable to DI Water Piping

HRRF _____- __ __ _ _ _ _ DM

With electric conductivity control function, Applicable to DI water piping


By entering the set value of electric conductivity and hysteresis, flow of circulating fluid to the DI filter is controlled by the solenoid valve to control electric conductivity. Contact material of the circulating fluid circuit is made from non-copper materials. (For details, refer to Option M.)

Applicable model	HRRF012/018-□□-20-DM
Measurement range of electric conductivity	0.1 to 48.0 μS/cm
Set range of target electric conductivity	0.5 to 45.0 μS/cm*1
Set range of electric conductivity hysteresis	0.1 to 10.0 μS/cm

^{*1} Default setting is set to "Electric conductivity set value: 25.0 μS/cm" and "Hysteresis: 5.0 μS/cm."

Example of operation of electric conductivity control

- · Electric conductivity target value : 25.0 [μS/cm]
- · Electric conductivity control hysteresis: 5.0 [μ S/cm]

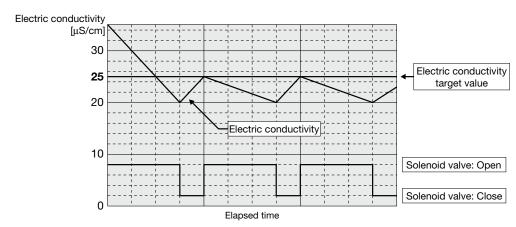



Applicable to DI Water Piping

HRRF_____-__-20-M

Applicable to DI water piping
 ■

Contact material of the circulating fluid circuit is made from non-copper materials.

- · Available DI water is electric conductivity: 0.4 μ S/cm or more. (Electric resistivity: 2.5 M Ω ·cm or less)
- This Option M does not have electric resistance/electric conductivity control function. If this function is necessary, Option DM should be selected.

Applicable model	HRRF012/018-□□-20-M
Contact material for circulating fluid	Stainless steel (including heat exchanger brazing), Alumina ceramic, SiC, Carbon, PP, PE, POM, PA, FKM, EPDM, PVC, PPS, AS

* No change in external dimensions



T1 Option

Option symbol

Inverter Pump Mounted

HRRF _____-20-<u>T1</u>

Inverter pump mounted

Possible to choose an inverter pump in accordance with user's piping resistance Cooling capacity will decrease by heat generated in the pump.


- · The inverter pump does not use a mechanical seal.
- The 50 Hz and the 60 Hz inverter pumps have the same capacity. (There is no pump capacity difference between the 50 Hz and the 60 Hz.)

	Applicable model		HRRF012/018-□□-20-T1
	Rated flow (50/60 Hz)*1, *2	L/min	10 (0.28 MPa)
Pump	Max. pump head (50/60 Hz)	m	40
	Output	W	400
Circuit protector		Α	15
Recommended earth leakage breaker capacity		Α	15
Cooling capacity		W	The cooling capacity reduces about 300 W from the value in the catalog. Due to an increase in the heat generation of the pump.

- *1 The capacity at the thermo-chiller outlet when the circulating fluid temperature is 20°C.
- *2 Required minimum flow rate for maintaining the cooling capacity or temperature stability.
- * The product weight will decrease by 1 kg.
- * No change in external dimensions of this product.

Pump Capacity

HRRF012/018-□□-20-T1

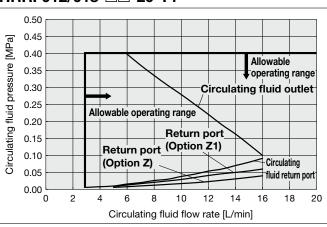

- * For Options "-Z" and "-Z1," operate within the range in which AL17 (flow rate failure) is not generated.
- The flow rate is displayed up to 16 L/min on the chiller display.



Option symbol

High-Pressure Pump Mounted

HRRF _____-____-20-T/MT

High-pressure pump mounted

Possible to choose a high-pressure pump in accordance with user's piping resistance

Cooling capacity will decrease by heat generated in the pump.


- · The high-pressure pump uses a mechanical seal.
- The thermo-chiller indicates maintenance notification when driving time is passed a recommended preventive maintenance hours. Please contact to service center to ask for maintenance of the pump and mechanical seal.

		HRRF012/018-□□-20-T	HRRF012/018-□□-20-MT*1	
	Rated flow (50/60 Hz)*2, 3	L/min	10 (0.42 MPa)/14 (0.40 MPa)	10 (0.32 MPa)/14 (0.32 MPa)
Pump	Max. pump head (50/60 Hz)	m	5	0
	Output	W	550	
Circuit protector A 15		5		
Recommended earth leakage breaker capacity		Recommended earth leakage breaker capacity A 15		5
Cooling capacity*4		W	The cooling capacity reduces about Due to an increase in the he	

- *1 Option MT: Applicable to DI water piping + High-pressure pump mounted
- *2 The capacity at the thermo-chiller outlet when the circulating fluid temperature is 20°C.
- *3 Required minimum flow rate for maintaining the cooling capacity or temperature stability.
- *4 Cooling capacity will decrease as pump power increases.
- * When the option, high-pressure pump mounted, is selected, the product weight increases by 5 kg.
- * No change in external dimensions of this product.


Pump Capacity

HRRF012/018-□□-20-T

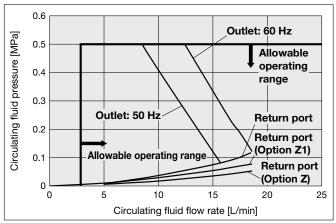

* The flow rate is displayed up to 16 L/min on the chiller display.

HRRF012/018-□□-20-MT

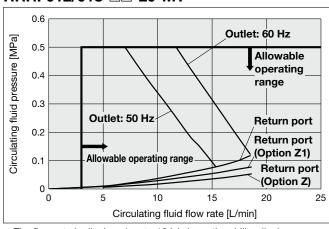

* The flow rate is displayed up to 16 L/min on the chiller display.


Options **HRRF** Series

 Options have to be selected when ordering the thermo-chiller.
 It is not possible to add them after purchasing the unit.




Option symbol


With Feet/Without Rack Mounting Brackets



Instead of the 19-inch rack mounting brackets, the product comes with rubber legs under its base.







Standard product without the parts below


Z	Flow sensor, Water leakage sensor, Particle filter, Bypass valve, Retaining clip
Z 1	Flow sensor, Retaining clip

HRRF Series Optional Accessories

① Concentration Meter

This meter can be used to control the concentration of ethylene glycol aqueous solution regularly.


Part number	Applicable model
HRZ-BR002	HRRF012/018



2 Particle Filter Element for Replacement

Element for the maintenance of the particle filter for circulating fluid

Part number	Applicable model
EJ202S-005X11	HRRF012/018



③ DI Filter Replacement Cartridge

DI filter cartridge for replacement for Option DM [Electric conductivity control type, DI water piping type]

Part number	Applicable model
HRR-DF001	HRRF012/018-□□-20-DM□



4 Anti-quake Bracket


Bracket for earthquakes

Prepare the anchor bolts (M8) which are suited to the floor material by the customer. (Anti-quake bracket material: Stainless steel, thickness: 1.5 mm)

Part number	Applicable model
HRR-TK001	HRRF012/018-□□-20-□Y□

Parts List

Description	Qty.
Anti-quake bracket A	2
Anti-quake bracket B	2
Nut (M8)	4
Bolt (M8)	4

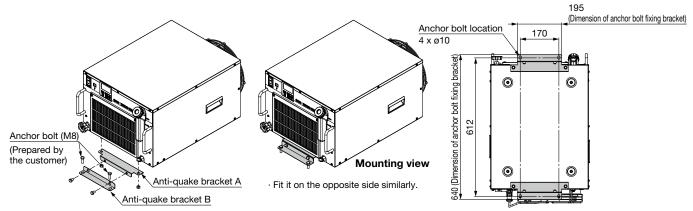


⑤ Piping Conversion Fitting (For Air-cooled Refrigeration)

■ Conversion fitting for circulating fluid + Conversion fitting for drain outlet

This fitting changes the port size for circulating fluid from Rc1/2 to G1/2 or NPT1/2, and for drain from Rc1/4 to G1/4 or NPT1/4. It is not necessary to purchase this when pipe thread type F or N is selected in "How to Order" since it is included in the product.

Part number		Applicable model	
HRR-EP001	G thread conversion fitting set	d conversion fitting set HRRF012/018-A-20	
HRR-EP002	NPT thread conversion fitting set	HNRU12/016-A-20	

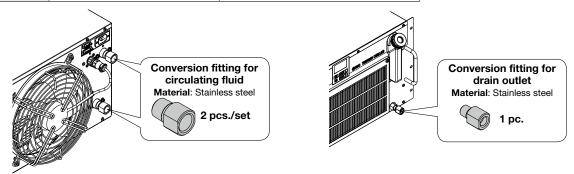



⑥ Piping Conversion Fitting (For Water-cooled Refrigeration)

■ Conversion fitting for circulating fluid + Conversion fitting for drain outlet

This fitting changes the port size for circulating fluid from Rc1/2 to G1/2 or NPT1/2, and for drain from Rc1/4 to G1/4 or NPT1/4. It is not necessary to purchase this when pipe thread type F or N is selected in "How to Order" since it is included in the product.

Part number		Applicable model	
HRR-EP003	G thread conversion fitting set	HRRF012/018-W-20	
HRR-EP004	NPT thread conversion fitting set	HNR-012/018-W-20	

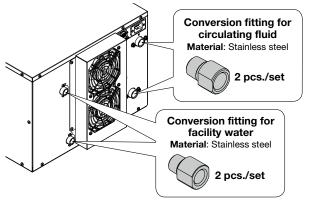



Power Supply Cable

Part number	Applicable model
HRR-CA001	HRRF012/018-□□-20



® Caster Adjuster-foot Kit


This is a set of unfixed casters and adjuster feet stop.


This kit can only be used for Option Y of the thermo-chiller HRR□ series.

Do not mount this kit on other products.


Carefully read the procedure manual included with this kit before performing the installation.

Part number Applicable model		A dimension [mm]	Weight [kg]
HRR-KS001	HRRF012/018-□□-20-□Y	417	Approx. 7



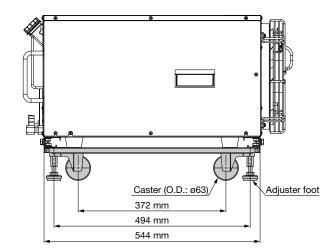

Mounting view

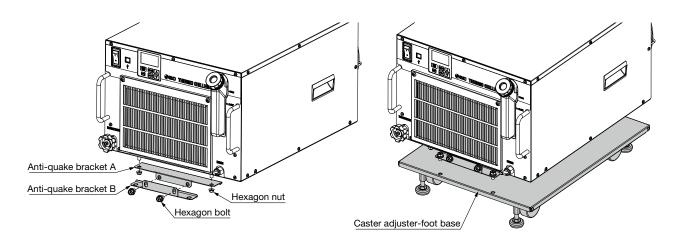



Parts List

Description	Qty.
Caster adjuster-foot base	1
Anti-quake bracket A	2
Anti-quake bracket B	2
Hexagon nut (M8)	4
Hexagon bolt (M8)	8
Mounting procedure manual	1



Cooling Capacity Calculation

Required Cooling Capacity Calculation

Example 1: When the heat generation amount in the user's equipment is known.

The heat generation amount can be determined based on the power consumption or output of the heat generating area — i.e. the area requiring cooling — within the user's equipment.*1 | Curre

① Derive the heat generation amount from the power consumption.

Power consumption P: 1000 [W]

$$Q = P = 1000 [W]$$

Cooling capacity = Considering a safety factor of 20%,

② Derive the heat generation amount from the power supply output.

Power supply output VI: 1.0 [kVA]

 $Q = P = V \times I \times Power factor$

In this example, using a power factor of 0.85:

$$= 1.0 [kVA] \times 0.85 = 0.85 [kW] = 850 [W]$$

Cooling capacity = Considering a safety factor of 20%,

③ Derive the heat generation amount from the output.

V: Power

supply voltage

P

consumption

Q: Heat generation

User's equipment

Output (shaft power, etc.) W: 800 [W]

$$Q = P = \frac{W}{\text{Efficiency}}$$

In this example, using an efficiency of 0.7:

$$=\frac{800}{0.7}=1143$$
 [W]

Cooling capacity = Considering a safety factor of 20%,

*1 The examples above calculate the heat generation amount based on the power consumption. The actual heat generation amount may differ due to the structure of the user's equipment. Be sure to check it carefully.

Example 2: When the heat generation amount in the user's equipment is not known.

Obtain the temperature difference between inlet and outlet by circulating the circulating fluid inside the user's equipment.

Heat generation amount by user's equipment Q: Unknown [W] ([J/s]) Circulating fluid : Tap water*1 Circulating fluid mass flow rate qm : (= $\rho \times qv \div 60$) [kg/s] : 1 [kg/dm³] Circulating fluid density p Circulating fluid (volume) flow rate qv : 10 [dm3/min] : 4.2 x 10³ [J/(kg·K)] Circulating fluid specific heat C Circulating fluid outlet temperature T1 : 293 [K] (20 [°C]) Circulating fluid return temperature T2 : 295 [K] (22 [°C]) Circulating fluid temperature difference ΔT $: 2.0 [K] (= T_2 - T_1)$ Conversion factor: minutes to seconds (SI units): 60 [s/min]


*1 Refer to page 15 for the typical physical property value of tap water or other circulating fluids.

$$Q = q_m \times C \times (T_2 - T_1)$$

$$= \frac{\rho \times q_{V} \times C \times \Delta T}{60} = \frac{1 \times 10 \times 4.2 \times 10^{3} \times 2.0}{60}$$

= 1400 [J/s] ≈ 1400 [W]

Cooling capacity = Considering a safety factor of 20%,

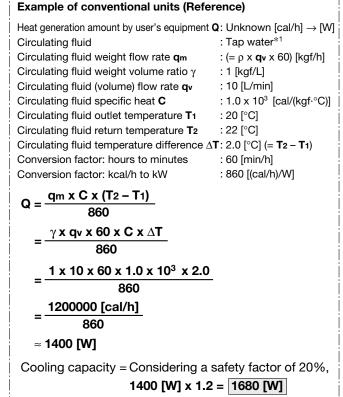

^{*} Calculation example for the temperature and flow rate based on customer's piping condition
For calculating the required cooling capacity based on the displayed value of temperature and flow rate in the chiller, fully close the bypass valve.



Required Cooling Capacity Calculation

Example 3: When there is no heat generation, and when cooling the object below a certain temperature and period of time.

Heat quantity by cooled substance (per unit time) Q: Unknown [W] ([J/s])

Cooled substance : Water

Cooled substance mass \mathbf{m} : $(= \rho \times \mathbf{V})$ [kg]

Cooled substance density ρ : 1 [kg/dm³]

Cooled substance total volume \mathbf{V} : 20 [dm³]


Cooled substance specific heat **C** : 4.2 x 10³ [J/(kg·K)]
Cooled substance temperature when cooling begins **To**: 305 [K] (32 [°C])

Cooled substance temperature when cooling begins $To: 305 \ [K] \ (32 \ [^{\circ}C])$ Cooled substance temperature after t hour Tt : 293 $[K] \ (20 \ [^{\circ}C])$ Cooling temperature difference ΔT : 12 $[K] \ (= To - Tt)$ Cooling time Δt : 900 $[s] \ (= 15 \ [min])$

* Refer to the following for the typical physical property values by circulating fluid.

$$Q = \frac{m \times C \times (T_0 - T_t)}{\Delta t} = \frac{\rho \times V \times C \times \Delta T}{\Delta t}$$
$$= \frac{1 \times 20 \times 4.2 \times 10^3 \times 12}{900} = 1120 \text{ [J/s]} \approx 1120 \text{ [W]}$$

Cooling capacity = Considering a safety factor of 20%,

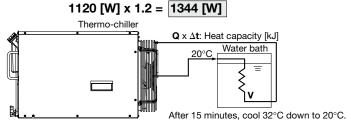

Heat quantity by cooled substance (per unit time) \mathbf{Q} : Unknown [cal/h] \rightarrow [W]

Cooled substance : Water

Cooled substance specific heat **C** : 1.0 x 10³ [cal/(kgf·°C)]

Cooled substance temperature when

cooling begins T_0 : 32 [°C] Cooled substance temperature after t hour T_t : 20 [°C]

Cooling temperature difference ΔT : 12 [°C] (= $T_0 - T_t$)

Cooling time Δt : 15 [min] Conversion factor: hours to minutes : 60 [min/h] Conversion factor: kcal/h to kW : 860 [(cal/h)/W]

$$Q = \frac{m \times C \times (T_0 - T_t)}{\Delta t \times 860} = \frac{\gamma \times V \times 60 \times C \times \Delta T}{\Delta t \times 860}$$

$$= \frac{1 \times 20 \times 60 \times 1.0 \times 10^3 \times 12}{15 \times 860}$$

≈ 1120 [W]

Cooling capacity = Considering a safety factor of 20%,

1120 [W] x 1.2 = 1344 [W]

Precautions on Cooling Capacity Calculation

1. Heating capacity

When the circulating fluid temperature is set above room temperature, it needs to be heated by the thermo-chiller. The heating capacity depends on the circulating fluid temperature. Consider the radiation rate and heat capacity of the user's equipment and check beforehand if the required heating capacity is provided.

2. Pump capacity

<Circulating fluid flow rate>

Circulating fluid flow rate varies depending on the circulating fluid discharge pressure. Consider the installation height difference between the thermo-chiller and the user's equipment, and the piping resistance such as circulating fluid pipings, or piping size, or piping curves in the machine. Check beforehand if the required flow is achieved, using the pump capacity curves.

<Circulating fluid discharge pressure>

Circulating fluid discharge pressure has the possibility to increase up to the maximum pressure in the pump capacity curves. Check beforehand if the circulating fluid pipings or circulating fluid circuit of the user's equipment are fully durable against this pressure.

Circulating Fluid Typical Physical Property Values

1. This catalog uses the following values for density and specific heat in calculating the required cooling capacity.

Density p: 1 [kg/dm³] (or, using conventional units, weight volume ratio $\gamma = 1$ [kgf/L]) Specific heat $\mathbf{C}: 4.19 \times 10^3$ [J/(kg·K)] (or, using conventional units, 1 x 10³ [cal/(kgf·°C)])

2. Values for density and specific heat change slightly according to temperature shown below. Use this as a reference. 15% Ethylene Glycol Aqueous Solution

Physical property value	Density ρ	Specific heat C	Conventional units	
Temperature	[kg/dm ³]	[J/(kg·K)]	Weight volume ratio γ [kgf/L]	Specific heat C [cal/(kgf·°C)]
5°C	1.00	4.2×10^3	1.00	1 x 10 ³
10°C	1.00	4.19 x 10 ³	1.00	1 x 10 ³
15°C	1.00	4.19 x 10 ³	1.00	1 x 10 ³
20°C	1.00	4.18 x 10 ³	1.00	1 x 10 ³
25°C	1.00	4.18 x 10 ³	1.00	1 x 10 ³
30°C	1.00	4.18 x 10 ³	1.00	1 x 10 ³
35°C	0.99	4.18 x 10 ³	0.99	1 x 10 ³
40°C	0.99	4.18 x 10 ³	0.99	1 x 10 ³

Physical property value	Density ρ	Specific heat C	Conventional units	
Temperature	[kg/dm ³]	[J/(kg·K)]	Weight volume ratio γ [kgf/L]	Specific heat C [cal/(kgf.°C)]
5°C	1.02	3.91×10^3	1.02	0.93 x 10 ³
10°C	1.02	3.91×10^3	1.02	0.93×10^3
15°C	1.02	3.91 x 10 ³	1.02	0.93×10^3
20°C	1.01	3.91 x 10 ³	1.01	0.93 x 10 ³
25°C	1.01	3.91 x 10 ³	1.01	0.93×10^3
30°C	1.01	3.91 x 10 ³	1.01	0.94 x 10 ³
35°C	1.01	3.91 x 10 ³	1.01	0.94 x 10 ³
40°C	1.01	3.92×10^3	1.01	0.94 x 10 ³

Shown above are reference values.



Example of conventional units (Reference)

^{*} This is the calculated value by changing the fluid temperature only. Thus, it varies substantially depending on the water bath or piping shape.



HRRF Series Specific Product Precautions 1

Be sure to read this before handling the products. Refer to the back cover for safety instructions. For temperature control equipment precautions, refer to the "Handling Precautions for SMC Products" and the "Operation Manual" on the SMC website.

Design

⚠ Warning

- 1. This catalog shows the specifications of a single unit.
 - Check the specifications of the single unit (contents of this catalog) and thoroughly consider the adaptability between the user's system and this unit.
 - 2) Although a protection circuit as a single unit is installed, prepare a drain pan, water leakage sensor, discharge air facility, and emergency stop equipment, depending on the user's operating conditions. Also, the user is requested to carry out a safety design for the whole system.
- When attempting to cool areas that are open to the atmosphere (tanks, pipes), plan your piping system accordingly.

When cooling open-air external tanks, arrange the piping so that there are coil pipes for cooling inside the tanks and to carry back the entire flow volume of circulating fluid that is released.

3. Use non-corrosive material for circulating fluid contact parts.

The recommended circulating fluid is tap water or 15% ethylene glycol aqueous solution. Using corrosive materials such as aluminum or iron for fluid contact parts such as piping may cause clogging or leakage in the circulating fluid circuit. Therefore, take sufficient care when selecting fluid contact part materials such as piping.

4. Design the piping so that no foreign matter enters the chiller.

If foreign matter, such as scales in the piping, enters the circulating fluid, this may cause the pump to malfunction.

5. This product uses a slightly flammable refrigerant (R454C). Avoid using this product in proximity to open flames.

Ensure compliance with local laws and regulations regarding the use and application of this product.






Transportation / Carriage / Movement

- 1. This product cannot be transported by air as this product uses a slightly flammable refrigerant (R454C).
- 2. This product is heavy. Pay attention to safety and the position of the product when it is transported, carried, and moved.
- 3. Read the operation manual carefully before moving the product after unpacking.

Transportation / Carriage / Movement

 Never put the product down on its side as this may cause failure.

The product will be delivered in the packaging shown below.



ſ	Model	Weight [kg]*1	Dimensions [mm]
ł			2
	HRRF012-A HRRF018-A	59	Height 575 x Width 610 x Depth 820
	HRRF012-W HRRF018-W		Height 373 x Width 610 x Depth 620

st For models with an option, the weight increases as shown below.

Option	Description	Product series	Additional weight
-DM	-DM With electric conductivity control function, Applicable to DI water piping		+1 kg
-M	Applicable to DI water piping	All series	Not changed
-T1	Inverter pump mounted	All series	–1 kg
-T	High-pressure pump mounted	All series	+5 kg
-Y	-Y With feet/Without rack mounting brackets Without either a flow sensor, water leakage sensor, particle filter, bypass valve or retaining clip		Not changed
-Z			–1 kg
- Z 1	Without either a flow sensor or retaining clip	All series	Not changed

If this product is to be transported after delivery, please use the original packaging the product was delivered in. If other packaging is to be used, carefully package the product so as to prevent the product from incurring any damage during transport.





HRRF Series Specific Product Precautions 2

Be sure to read this before handling the products. Refer to the back cover for safety instructions. For temperature control equipment precautions, refer to the "Handling Precautions for SMC Products" and the "Operation Manual" on the SMC website.

■ The circulating fluids listed below have been tested for thermo-chiller compatibility.

No.	Fluid	Manufacturer	Concentration
4	Dowcal™ 100 Heat	The Dow Chemical	Dilute to 30%
'	Transfer Fluid	Company	in water
2	ControXid 1642	Oelheld GmbH	Ready to use
3	Hexid A4	Applied Thermal Control Limited	Ready to use
4	Coolflow IGE	Hydratech Division of Liquitherm Technologies Group Ltd	Dilute to 25% in water
5	NALCO® CCL105 Nalco Water, an Ecolab Company		Ready to use

- The chiller cooling capacity and pump capacity performance may change with using the fluids listed. Customers should verify the performances with the fluid and decide to use the fluid.
- Check the compatibility with the piping and the wetted parts of the customer's equipment before use.
- Check with the circulating fluid manufacturer for the following.
 - 1) Countries and regions where it can be obtained and used
 - 2) Handling and maintenance
 - 3) Safety data sheets
 - 4) Specifications and physical properties
- Concentration has to be value listed or less. Overly high concentrations can cause a pump overload. Low concentrations, however, can lead to freezing when circulating fluid temperature is 10°C or lower and cause the thermo-chiller to break down.
- Using the fluid listed for a long time, the chiller heat exchanger performance may be reduced due to additive deposits. It is recommended to regularly flush the inside of the piping and chiller with clean water.
- In the case of a mechanical seal pump, additive deposits may appear on the outside, it is not a malfunction.

■ Refrigerant with GWP reference

Refrigerant	Global Warming Potential (GWP)		
	Regulation (EU) 2024/573, AIM Act 40 CFR Part 84	Fluorocarbon Emissions Control Act (Japan)	
		GWP value labeled on products	GWP value to be used for reporting the calculated amount of leakage
R134a	1,430	1,430	1,300
R404A	3,922	3,920	3,940
R407C	1,774	1,770	1,620
R410A	2,088	2,090	1,920
R448A	1,386	1,390	1,270
R454C	146	145	146

^{*1} This product is hermetically sealed and contains fluorinated greenhouse gases.



^{*2} For refrigerant type used in this product, refer to the product specifications.



Temperature Control Equipment These safety instructions are intended to prevent hazardous situations and/or equipment damage. These instructions indicate the level of potential hazard with the labels of "Caution," "Warning" or "Danger." They are all important notes for safety and must be followed in addition to International Standards (ISO/IEC), and other safety regulations.

🗥 Danger :

Danger indicates a hazard with a high level of risk which, if not avoided, will result in death or serious injury.

Warning indicates a hazard with a medium level of Warning: risk which, if not avoided, could result in death or serious injury.

Caution indicates a hazard with a low level of risk Market in minor or which, if not avoided, could result in minor or moderate injury.

∕ Warning

1. The compatibility of the product is the responsibility of the person who designs the equipment or decides its specifications.

Since the product specified here is used under various operating conditions, its compatibility with specific equipment must be decided by the person who designs the equipment or decides its specifications based on necessary analysis and test results. The expected performance and safety assurance of the equipment will be the responsibility of the person who has determined its compatibility with the product. This person should also continuously review all specifications of the product referring to its latest catalog information, with a view to giving due consideration to any possibility of equipment failure when configuring the equipment.

2. Only personnel with appropriate training should operate machinery and equipment.

The product specified here may become unsafe if handled incorrectly. The assembly, operation and maintenance of machines or equipment including our products must be performed by an operator who is appropriately trained and experienced.

- 3. SMC products cannot be used beyond their specifications. They are not developed, designed, and manufactured to be used under the following conditions or environments. Use under such conditions or environments is not allowed.
 - 1. Conditions and environments outside of the given specifications, or use outdoors or in a place exposed to direct sunlight.
 - 2. Use for nuclear power, railways, aviation, space equipment, ships, vehicles, military application, equipment affecting human life, body, and property, combustion equipment, entertainment equipment, emergency shut-off circuits, press clutches, brake circuits, safety equipment, etc., and use for applications that do not conform to standard specifications such as catalogs and operation manuals.
 - 3. Use for interlock circuits, except for use with double interlock such as installing a mechanical protection function in case of failure. Please periodically inspect the product to confirm that the product is operating properly.

⚠ Caution

SMC develops, designs, and manufactures products to be used for automatic control equipment, and provides them for peaceful use in manufacturing industries.

Use in non-manufacturing industries is not allowed.

Products SMC manufactures and sells cannot be used for the purpose of transactions or certification specified in the Measurement Act of each country

The new Measurement Act prohibits use of any unit other than SI units in Japan.

Compliance Requirements

- The use of SMC products with production equipment for the manufacture of weapons of mass destruction (WMD) or any other weapon is strictly prohibited.
- 2. The exports of SMC products or technology from one country to another are governed by the relevant security laws and regulations of the countries involved in the transaction. Prior to the shipment of a SMC product to another country, assure that all local rules governing that export are known and followed.

Limited warranty and Disclaimer/ **Compliance Requirements**

The product used is subject to the following "Limited warranty and Disclaimer" and 'Compliance Requirements" Read and accept them before using the product.

Limited warranty and Disclaimer

The warranty period of the product is 1 year in service or 1.5 years after the product is delivered, whichever is first.

2. Scope

For any failure reported within the warranty period which is clearly our responsibility, replacement parts will be provided. In that case, removed parts shall become the property of SMC.

This guarantee applies only to our product independently, and not to any other damage incurred due to the failure of the product.

3. Content

The following situations are out of scope of this warranty.

- 1. The product was incorrectly installed or connected with other equipment.
- The product was modified or altered in construction.
- The product was modified or altered in construction.
 The failure was a secondary failure of the product caused by the failure of equipment connected to the product.
- 4. The failure was caused by a natural disaster such as an earthquake, typhoon, or flood, or by an accident or fire.
- The failure was caused by operation different from that shown in the Operation Manual or outside of the specifications.
- 6. The checks and maintenance specified (daily checks and regular checks) were not performed.
- 7. The failure was caused by the use of circulating fluid or facility water other than those specified.
- 8. The failure occurred naturally over time (such as discoloration of a painted or plated face).
- 9. The failure does not affect the functioning of the product (such as new
- sounds, noises and vibrations).

 10. The failure was due to the "Installation Environment" specified in the Operation Manual.

4. Disclaimer

- . Expenses for daily and regular checks
- Expenses for repairs performed by other companies
- Expenses for transfer, installation and removal of the product
- Expenses for replacement of parts other than those in this product, or for the supply of liquids
- 5. Inconvenience and loss due to product failure (such as telephone bills, compensation for workplace closure, and commercial losses

For warranted repair, please contact the supplier you purchased this product from.

↑ Safety Instructions Be sure to read the "Handling Precautions for SMC Products" (M-E03-3) and "Operation Manual" before use.

SMC Corporation